

Ultrasonic Heat Meter for Energy Metering







Clamp-on Compact Ultrasonic Heat Meter E3

Gentos Measurement & Control Co., Ltd.






Main characters:


The product is an integrated structure design, which is easy to install through 6 screws, and has special insulation on the outside. The jacket reduces the hassle of field installation. Its characteristic is that it can be measured with the buckle. There is no need to cut the pipe, and there is no need to stop. At the same time, it also has rich network functions, supporting Wi-Fi communication. And It can realize icloud data storage and analysis management functions. You can have access to "Gentos iCloud" or your own icloud data center. Data collection can meet different working conditions.

TCT Technology

TCT Technology

The TCT (Time Comb Technology) is a kind of technology used to measure signal flight time. The technology is invented by Gentos Measurement & Control Co., Ltd. in 2019. Since the technology was invented, it has achieved the time measurement accuracy of 50ps (TVT is 130ps), and has outstanding characteristics of high accuracy, high stability and low cost.








Working Principle

When the ultrasonic signal is transmitted and received through the moving liquid, there will be a difference between the upstream and downstream transit time, which can be used to calculate flow and velocity.



Upstream Transducer

Installation Steps

The clip on meter is measured with an integrated design. The installation is very simple. There is no need to break the pipe, stop the pump, and set parameter. E3 is directly clipped on the pipe section, and tightened the screw to turn on the power flow measurement.









	Performance specifications
Flow range	$\pm 0.098 ft/s \sim \pm 16 ft/s \; (\pm 0.03 m/s \sim \pm 5 m/s)$
Accuracy	±2%
Pipe size	DN20 DN25 DN32 DN40 DN50 DN65 DN80
Fluid	Water
Pipe material	PVC, Carbon Steel, Stainless Steel, Copper
	Function specifications
Outputs	Analog output: WiFi, 4~20mA, Rs485, OCT Pulse, Relay
Communication interface	WIFI/TTL, RS485/TTL, OCT/Relay, 4-20mA/TTL Support FUJI protocol and MODBUS protocol
Power supply	10~36VDC/500mA
Temperature	Transmitter: $14^{\circ}F^{-}122^{\circ}F(-10^{\circ}C^{-}50^{\circ}C)$ Transducer measurement medium: $32^{\circ}F^{-}140^{\circ}F(0^{\circ}C^{-}60^{\circ}C)$
Humidity	Up to 99% RH,non-condensing
	Physical specifications
Transmitter	PC/ABS
Keyboard	3 touch Keys
Display	1.44"LCD
Protection Rate	lp54
Cable Lenght	Power cable: standard lenght 2m Temperature cable: 3.0m Φ5 6-Core,standard length 2m
	Type of Temperature sensor
PT1000	$2*PT1000$ Clamp-on or insertion temperature sensor 0^100° C(32 $^212^{\circ}$ F)

Dimensions Unit:mm Pipe material(PVC, Carbon Steel, Stainless Steel)									
Model	Ø	W	W1	L	L1	Н	Flow Range	Weight(kg)	
DN20	25~29	60	51	105	115	121	0.04~6	0.00	
DINZU	21~25	60	51	105	115	121	0.04 6	0.88	
DN25	32~36	60	56	105	115	128	0.05~9	0.01	
DINZS	28~32	60	56	105	115	128	0.03 9	0.91	
DN32	39~43	60	63	105	115	135	0.09~15	1.02	
DNSZ	35~39	60	63	105	115	135	0.09 13		
DN40	50~54	60	74	105	115	146	0.13~23	1.16	
DN40	46~50	60	74	105	115	146	0.13 23	1.10	
DN50	63~67	60	89	105	115	159	0.20~35	1.3	
DNO	59~63	60	89	105	115	159	0.20 33	1.5	
	76~80	60	102	105	115	172	0.35~60	1.8	
DN65	72-76	60	102	105	115	172	0.33 00	1.0	
DN80	87~91	60	113	105	115	183	0.55~90	2.2	
	83~87	60	113	105	115	183	0.55 90	۷.۷	

Dimensions Unit:mm Pipe material(Copper)									
Model	Ø	W	W1	L	L1	Н	Flow Range	Weight(kg)	
DN20	25~29	60	51	105	115	121	0.04~6	0.00	
DNZU	21~25	60	51	105	115	121	0.04 6	0.88	
DN25	25~29	60	56	105	115	128	0.05~9	0.01	
DNZS	21~25	60	56	105	115	128	0.03 9	0.91	
DN32	32~36	60	63	105	115	135	0.09~15	1.02	
DNSZ	28~32	60	63	105	115	135	0.09 13	1.02	
DN40	39~43	60	74	105	115	146	0.13~23	1.16	
DN40	35~39	60	74	105	115	146	0.13 23	1.10	
DN50	50~54	60	89	105	115	159	0.20~35	1.3	
DNSO	46~50	60	89	105	115	159	0.20 33	1.5	
DN65	63~67	60	102	105	115	172	0.35~60	1.8	
פטאוט	59~63	60	102	105	115	172	0.33 00	1.0	
DN80	76~80	60	113	105	115	183	0.55~90	2.2	
DINOU	72~76	60	113	105	115	183	0.55 50	2.2	

Building Energy Saving



Applications

It can be widely used in saving-energy, air-conditioning, building automation system, data central, energy audit, HVAC, etc















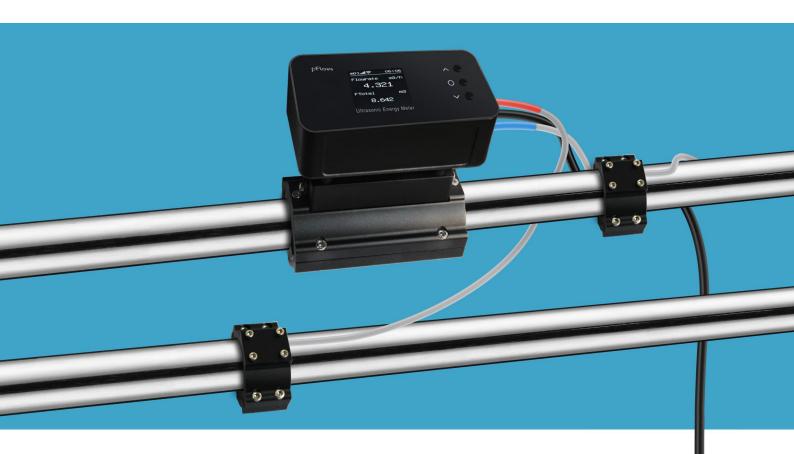

Clamp-on type ultrasonic flow meter is for the difficulty of installing a conventional model in an old building. It features with clamp-on PT1000 temperature sensor, no need to cut pipes and to shut down machines.

Easy operation menu Display instantaneous heating energy and accumulated heating energy Display instantaneous cooling energy and accumulated cooling energy Displaying Instantaneous Flow and Selecting Flow Units Optional unit: m3/h, l/m, gpm(UK), cfm, gpm(USA) Display instantaneous energy and select energy units Optional unit: KJ/h, MJ/h, GJ/h, Kcal/h, Mcal/h, KWh, MWh, Kbtu/h

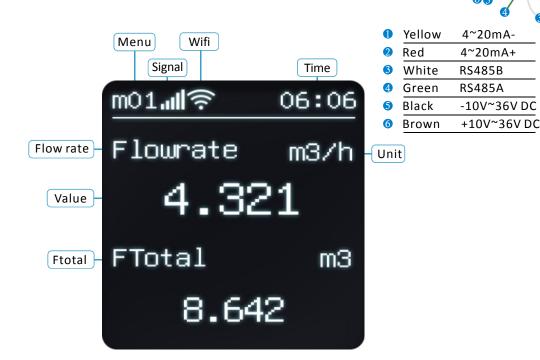



The meter has Gentos icloud energy efficiency monitoring function. Users can log in the account and password that we offer to scan all data on WeChat public number-----SMART METERS and website.

Users can inquire directly and clearly all data of each meter, and can observe its corresponding data curve and data report according to related data.

Also, E3 can add meter billing system, has independent background management page. It is easy to set cost unit price, cost data and consumption. It can generate monthly cost bill and cost report.

Air_Conditioning_Expense_Report									
House number	Device name	Last reading date	Last reading (kwh)	Now reading date	Now reading (kwh)	Usage amount (kwh)	unit price	cost (\$)	Billing mode
1	А	Year-Month-Day	520118	Year-Month-Day	551992	31874	0.8	25499.2	Totalizer Cool
2	В	Year-Month-Day	1634	Year-Month-Day	1782	148	0.8	118.4	Totalizer Cool
3	С	Year-Month-Day	1867	Year-Month-Day	2128	261	0.8	208.8	Totalizer Cool
4	D	Year-Month-Day	3694	Year-Month-Day	4239	545	0.8	436	Totalizer Cool
5	E	Year-Month-Day	33978	2019-11-30	38788	4810	0.8	3848	Totalizer Cool
Total					30110	.4			

Central air-conditioning is widely applied in business comprehensive complex, whose energy consumption covers more than 50% of energy consumption of the whole building complex. Thus, China proposes to create green savingenergy building environment.

The actual energy consumption of air-conditioning is closely related to the interests and benefits of all users. According to the survey and statistics, because the air-conditioning fee is charged on the basis of accumulation, this phenomenon leads to a great waste of energy.

The difficult problem of central air-conditioning billing perplexes property companies all the time. They want to achieve accurate metering and reasonable billing like water meters, electricity meters and gas meters. We follow the law of market economy, and pay as much as you use, which makes all users satisfied, build saving-energy awareness, promoting building saving-energy.



Ordering Information

Default Parameters:

Flow Range: 0.03m/s ± 5 m/s (0.1ft/s $\sim \pm 16$ ft/s)

Accuracy:± 2.0%
Repeatability: 0.8%
Display: LCD1.44"
Keyboard: 3 touch keys
Protection Rate: IP54 Housing
Enclosure ABS+PC Material
Power supply: 10-36VDC, 500mA
Transducer (Flow senor)Clamp-on type

Operating Temperature: 0°C~60°C (32F°~140F°)

Cable:2m (7ft) Length



Optional Parameters:								
Code	Output (optional 1 of 3)							
1	4-20mA							
2		W	iFi					
3		RS-	485					
4	OCT Pulse+Relay							
Code	Pipe Material (optional 1 of 4)							
А	A1: PVC	A2: Carbon Steel	A3: Stainless Steel	A4: Copper				
Code	Pipe Size(optional 1 of 7)							
	Nor	minal	Outer Diameter					
	Metric	Inch	Metric	Inch				
	DN20	3/4"	21~29mm	1.05"				
DN	DN25	1"	28~36mm	1.315"				
	DN32	1-1/4"	35~43mm	1.66"				
	DN40	1-1/2"	46~54mm	1.9"				
	DN50	2"	59~67mm	2.375"				
	DN65	2-1/2"	72~80mm	2.875"				
V N 1 50 5	DN80	3"	83~91mm	3.5"				

You Need: E3 Flowmeter with RS485 output+ for PVC + for Pipe DN20

So you select: B-3-A1-DN20

Gentos Measurement & Control Co., Ltd.

12/F, Block A5. Nanshan Ipark, No.1001 College Rd. Nanshan District. Shenzhen, China

UAE -Support

E - m a i l : Sales@measurmart.com